


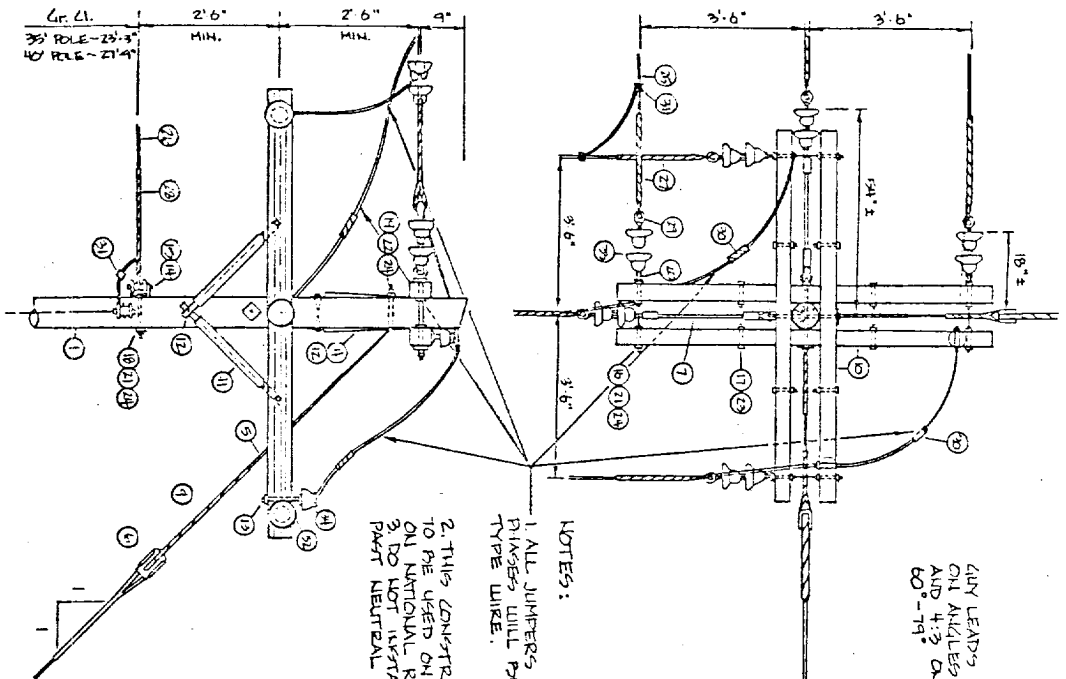

4:3 ON ANGLES OF 60°-79°

NOTES:

1. ALL JUMPERS ON CONDUCTOR SPICES WILL BE INSULATED TYPE WIRE.

2. THIS CONSTRUCTION STANDARD TO BE USED ON ALL LINES PHASED ON NATIONAL RESERVE LINES. 3. DO NOT INSTALL GROUND WIRE PART NEUTRAL CONDUCTOR.

ITEM	DESCRIPTION	QTY
1	POLE, 18'-2" HGT.	1
2	ANCHOR, 8" DIA.	2
3	ANCHOR ROD, 3/4" x 7'	2
4	CLAMP, 3/4" x 1/2"	2
5	CLAMP, 3/4" x 1/2"	2
6	CLAMP, 3/4" x 1/2"	2
7	CLAMP, 3/4" x 1/2"	2
8	CLAMP, 3/4" x 1/2"	2
9	CLAMP, 3/4" x 1/2"	2
10	CLAMP, 3/4" x 1/2"	2
11	CLAMP, 3/4" x 1/2"	2
12	CLAMP, 3/4" x 1/2"	2
13	CLAMP, 3/4" x 1/2"	2
14	CLAMP, 3/4" x 1/2"	2
15	CLAMP, 3/4" x 1/2"	2
16	CLAMP, 3/4" x 1/2"	2
17	CLAMP, 3/4" x 1/2"	2
18	CLAMP, 3/4" x 1/2"	2
19	CLAMP, 3/4" x 1/2"	2
20	CLAMP, 3/4" x 1/2"	2
21	CLAMP, 3/4" x 1/2"	2
22	CLAMP, 3/4" x 1/2"	2
23	CLAMP, 3/4" x 1/2"	2
24	CLAMP, 3/4" x 1/2"	2
25	CLAMP, 3/4" x 1/2"	2
26	CLAMP, 3/4" x 1/2"	2
27	CLAMP, 3/4" x 1/2"	2
28	CLAMP, 3/4" x 1/2"	2
29	CLAMP, 3/4" x 1/2"	2
30	CLAMP, 3/4" x 1/2"	2
31	CLAMP, 3/4" x 1/2"	2
32	CLAMP, 3/4" x 1/2"	2
33	CLAMP, 3/4" x 1/2"	2
34	CLAMP, 3/4" x 1/2"	2

DATE: 7-15-77	TITLE: PRIMARY ANGLE STRUCTURE
DRAWN BY: TYPY/11	60°-90° 12,500 VOLT AC
DESIGN BY:	
CHECKED BY: SP	PRODUCTION DEPT.
APPROVED BY: SP	HOURS: 0
SCALE: 1/2"=1'	ES-27