


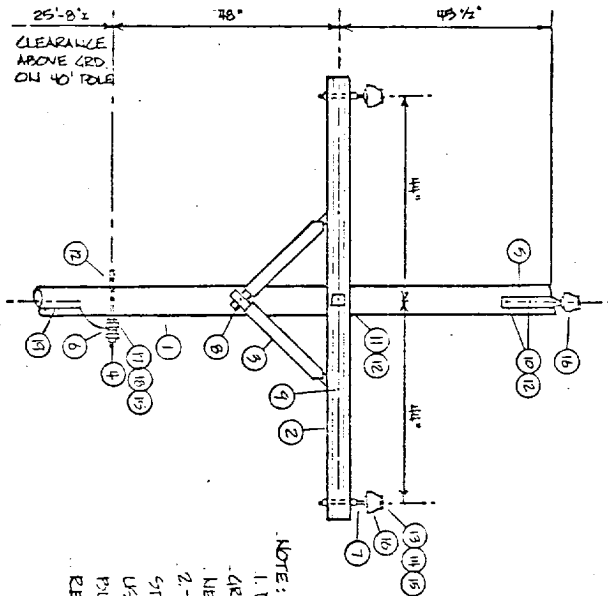

NOTE:
1. DO NOT INSTALL
GROUND WIRE FIRST
NEUTRAL CONDUCTOR
2. THIS CONSTRUCTION
STANDARD TO BE
USED ON ALL LINES
BUILT ON NATIONAL
RESOURCE LANDS

MATERIALS					
ITEM	DESCRIPTION	REQ'D	ITEM	DESCRIPTION	REQ'D
1	POLE, 40'	1	17	NEUTRAL CONDUCTOR	-
2	CROSSARM, 3/4"x 4 1/2" x 8'	1	18	ARMOR, ROD	1
3	PRIME, WOOD	2	19	POLE GROUND WIRE, #6 CU.	5*
4	GRUD RAIL	-			
5	BRIDE, 1/4" x 1/2"	-			
6	STEEL INSULATOR	-			
7	STEEL PIN, 1/8" x 5"	2			
8	LVL, 4"x 8", 1/2" x 4"	1			
9	CARBIDE POLE, 3/8" x 4 1/2"	2			
10	WAXHOLE POLE, 3/8" x 4"	2			
11	WAXHOLE POLE, 3/8" x 4"	1			
12	WAXHOLE, 2 1/2" x 4"	5			
13	PHASE CONDUCTOR	-			
14	ARMOR, ROD	3			
15	THE WIRE, #6 AL.	1*			
16	PIN INSULATOR, 4KV	3			

DATE: 7-15-77	TITLE: PRIMARY 12,000 VOLT POLE
DRAWN BY: J. Morrell	12,000 VOLT AXR
DESIGN BY:	
CHECKED BY: SL	PRODUCTION DEPT.
APPROVED BY: SL	CONOCO
SCALE: 1/4" = 1'-0"	HOBBBS DIVISION
	DRAWING NO. E9-26