


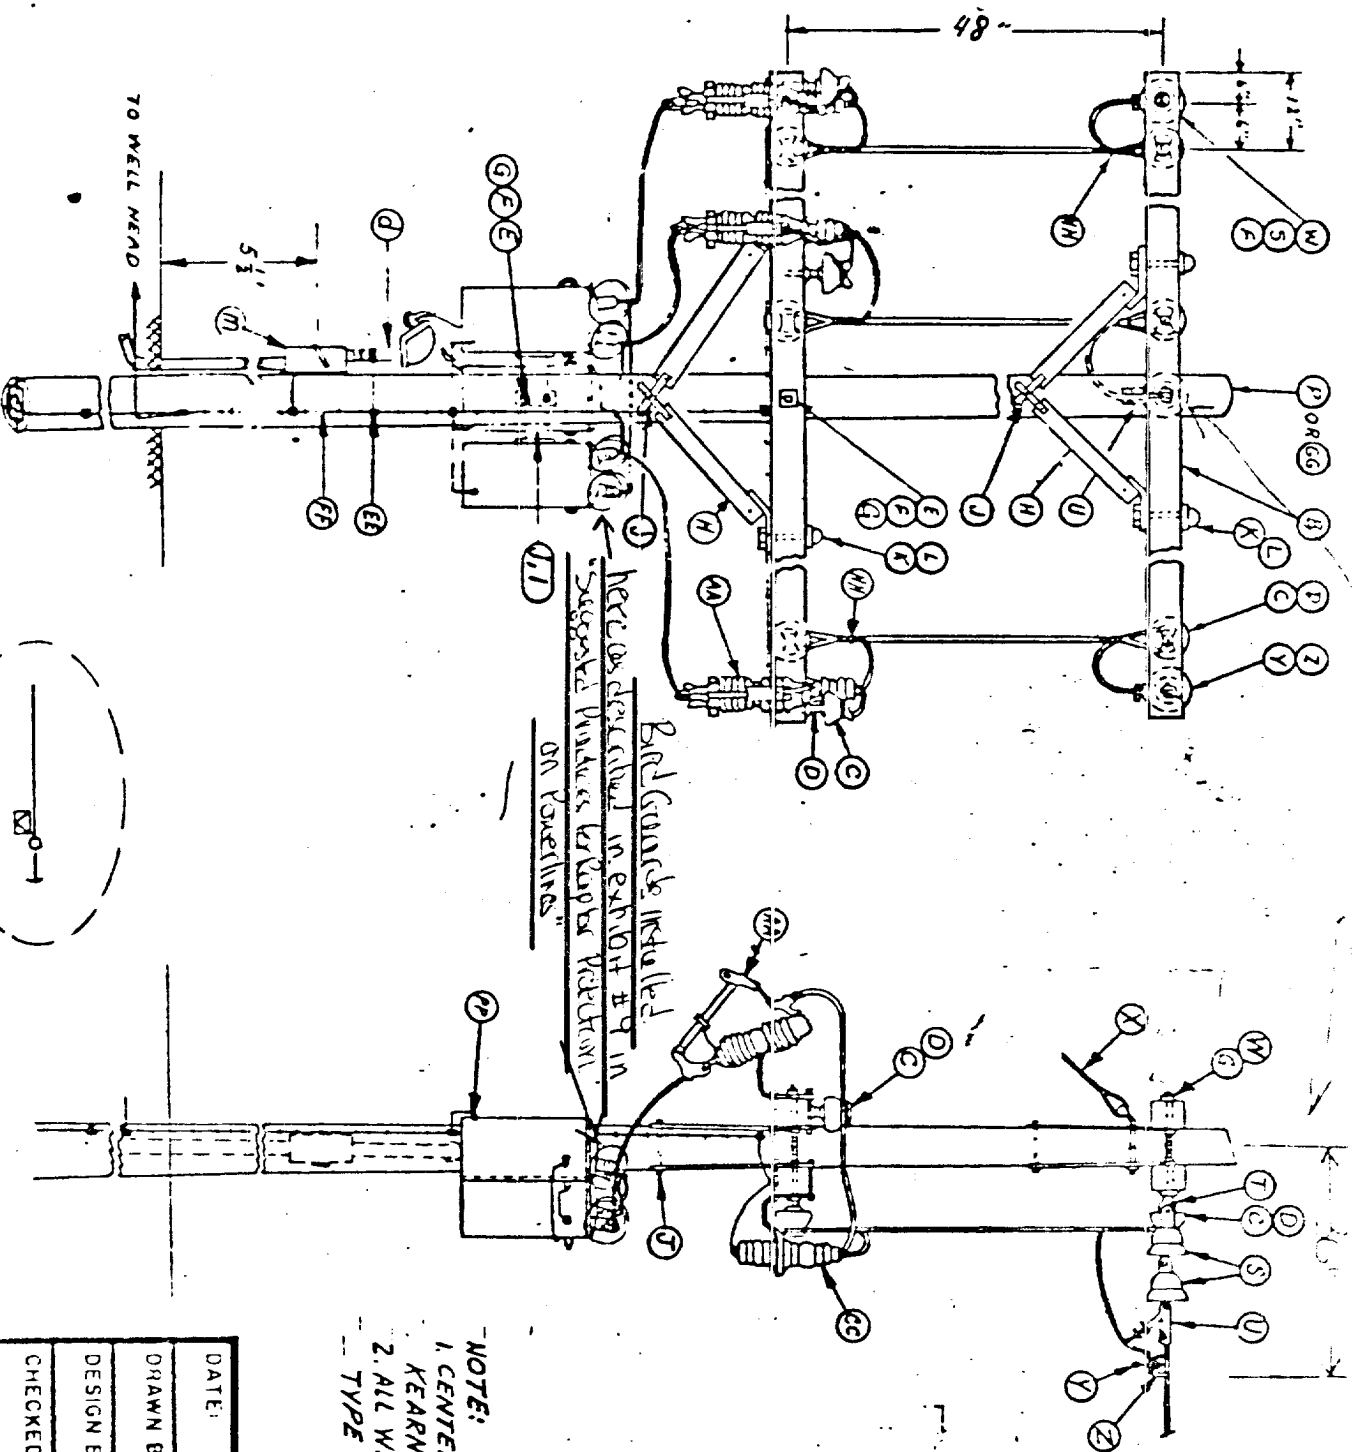

ITEM	QTY	REF
A	4	
B	9	
C	9	
D	9	
E	3	
F	24	
G	12	
H	9	
I	4	
J	8	
K	8	
L	8	
PortG	1	ES-1A, NOTE 5
S	6	
T	3	
U	3	
V	5	
W	1	
X	3	
Y	3	
Z	3	
AA	3	
CC	3	
EE	8	
FF	1	
HH	6	
I	1	
LI	1	ES-1A, NOTE 2
MI	1	
PP	3	

NOTE:
 1. CENTER PHASE ON BANK WILL HAVE EPOXY INS.
 KEARNY NO. 323015-24 INSULATOR.
 2. ALL WIRE FROM POINT "U" WILL BE INSULATED
 TYPE WIRE ON TRANSFORMER BANK.

DATE:	12-13-71	TITLE:	CONOCO NOTE SUBSTA.
DRAWN BY:	SPD	1PH TRANS. CLUSTER MOUNT	
DESIGN BY:	SPD	PRINT DEAD-END-12500/480V AGSR	
CHECKED BY:		PRODUCTION DEPT.	CONOCO
APPROVED BY:		HOBBS DIVISION	
SCALE:	NONE	ES-9	

RECEIVED

JUN 2 1977

U.S. CONSERVATION COMM.
FEDERAL BUREAU OF INVESTIGATION