


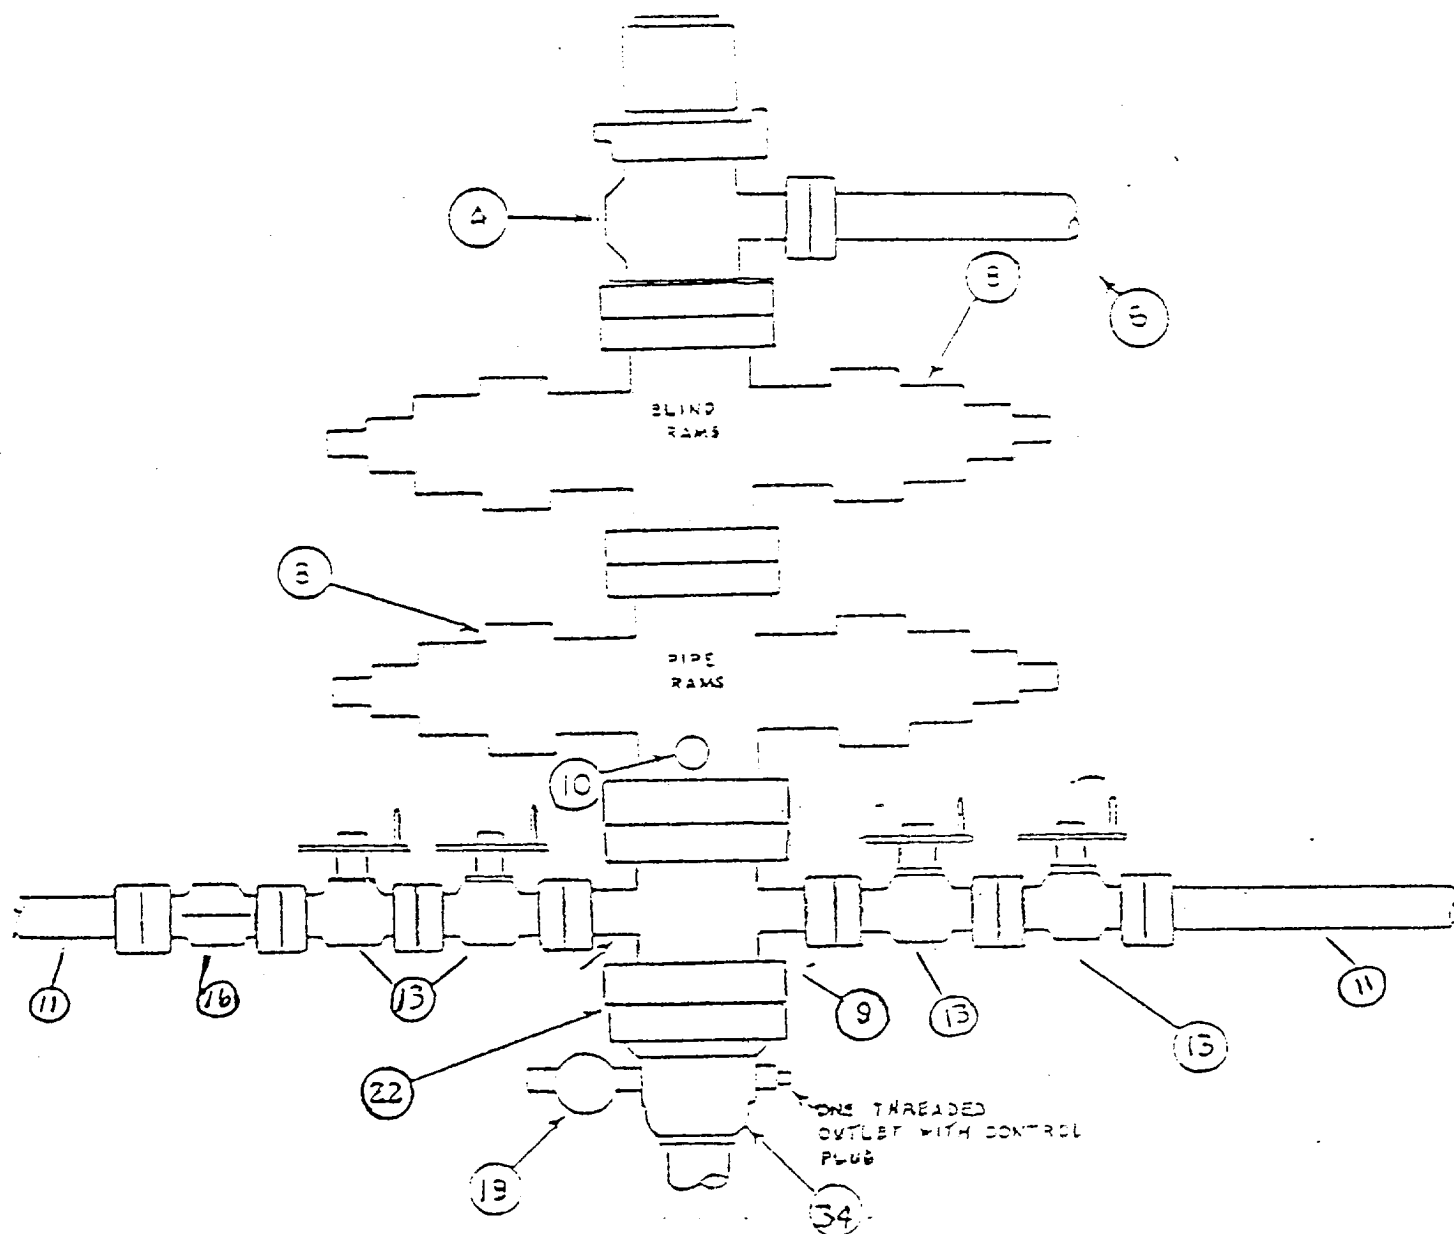

- (4) 3000 psi WP Rotating Head
- (6) 7" Pipe (Flow Line)
- (8) 3000 psi WP Ram Type Preventer
- (9) 3000 psi WP Spool W/Flanged Outlets
- (10) Studded or Flanged Outlet W/ Plate; Note: Only if present
- (11) 2 Inch Flow Line
- (13) 2-1/16 inch Minimum Bore, 3000 psi WP, Gate Valves
- (16) 3000#, 2-1/16 inch check valve
- (19) 2 inch Minimum Bore, 3000 psi WP, Gate Valve
- (22) 11", 3000# Flange, W/Ring Gasket
- (34) 3000#, 11", Wellhead W/Control Plug

RECEIVED

MAY - 8 1979

CL CONSTRUCTION CORP
1000 12th St