


CENTRALIZED TANK*BATTERY HOOK-UP FOR C.C. FRISTOE
WELLS NOS. 2 & 3

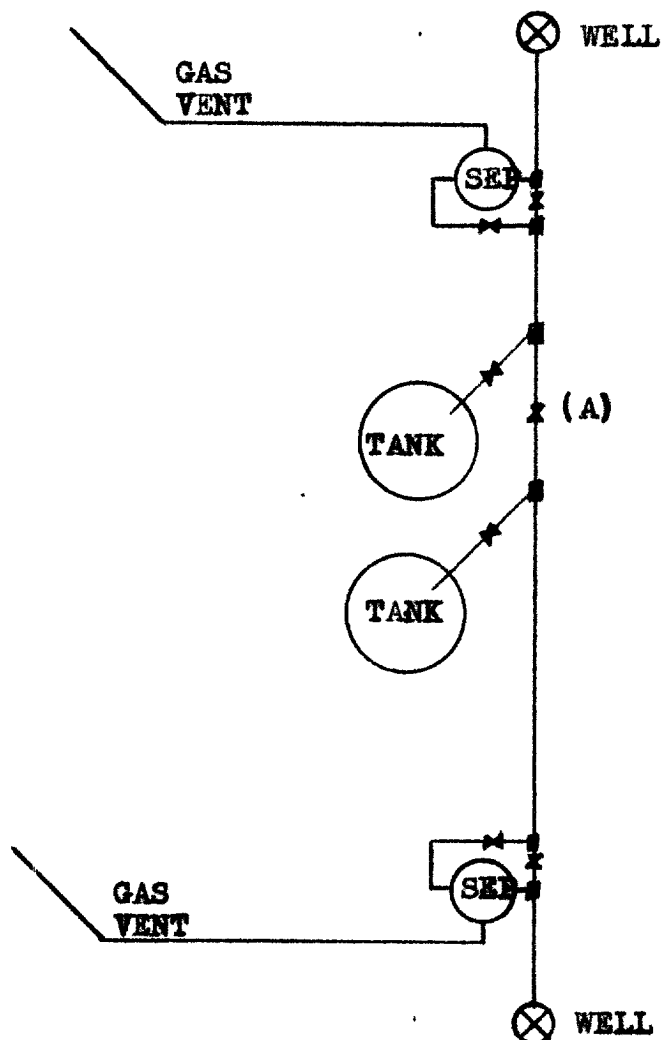

**NOTE:- BY CLOSING GATE MARKED (A) ON LINE BETWEEN THE TWO TANKS
 BOTH WELLS MAY BE TESTED INTO SEPARATE TANKS.**

—■— TEE

—△△— GATE VALVE