


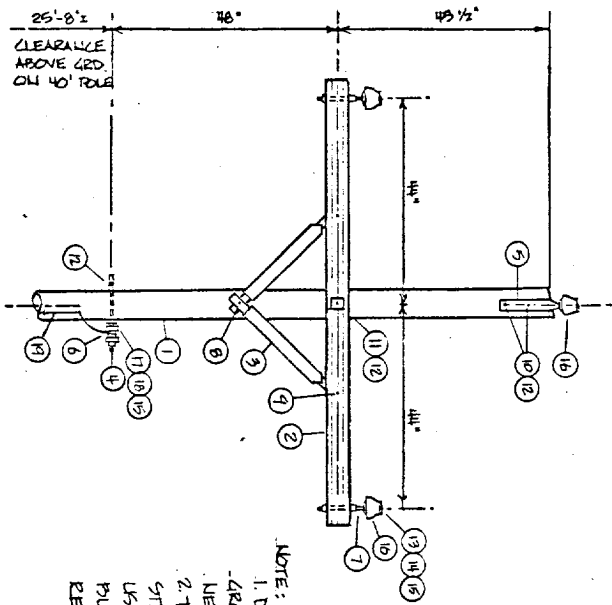

NOTE:
 1. DO NOT INSTALL
 -GROUND WIRE FIRST
 NEUTRAL CONDUCTOR
 2. THIS CONSTRUCTION
 STANDARD TO BE
 USED ON ALL LINES
 BUILT ON NATIONAL
 RESOURCE LANDS

MATERIALS					
ITEM	DESCRIPTION	REQD.	ITEM	DESCRIPTION	REQD.
1	POLE, 40'	1	17	NEUTRAL CONDUCTOR	-
2	CROSSARM 3/4"x 4 1/2" x 6'	1	18	ARMOR ROD	50
3	PLATE, WOOD	2	19	POLE GROUND WIRE, #6 CU.	50
4	STUD BOLT	-			
5	BIDGE PIN 1/2"	1			
6	SPRIG INSULATOR	1			
7	STEEL PIN 1/2" x 5"	2			
8	LV. SCREW 1/2" x 4"	1			
9	CARBIDE BOLT 3/8" x 4 1/2"	2			
10	MACHINE BOLT 3/8" x 10"	2			
11	MACHINE BOLT 3/8" x 4"	1			
12	WASHER, 2 1/2" SQ.	5			
13	PLATE CONDUCTOR	-			
14	ARMOR ROD	3			
15	TIE WIRE, #6 AL.	10			
16	PIN INSULATOR, 9 KV	3			

DATE: 7-15-77	TITLE: PRIMARY 11 LINE POLE
DRAWN BY: J. HARTILL	12,000 VOLT ALR
DESIGN BY:	
CHECKED BY: SK	PRODUCTION DEPT. CONOCO
APPROVED BY: SK	HOBBS DIVISION
SCALE: 1/2"=1'-0"	13 EL. SPELDS
	DRAWING NO. E-2-26