


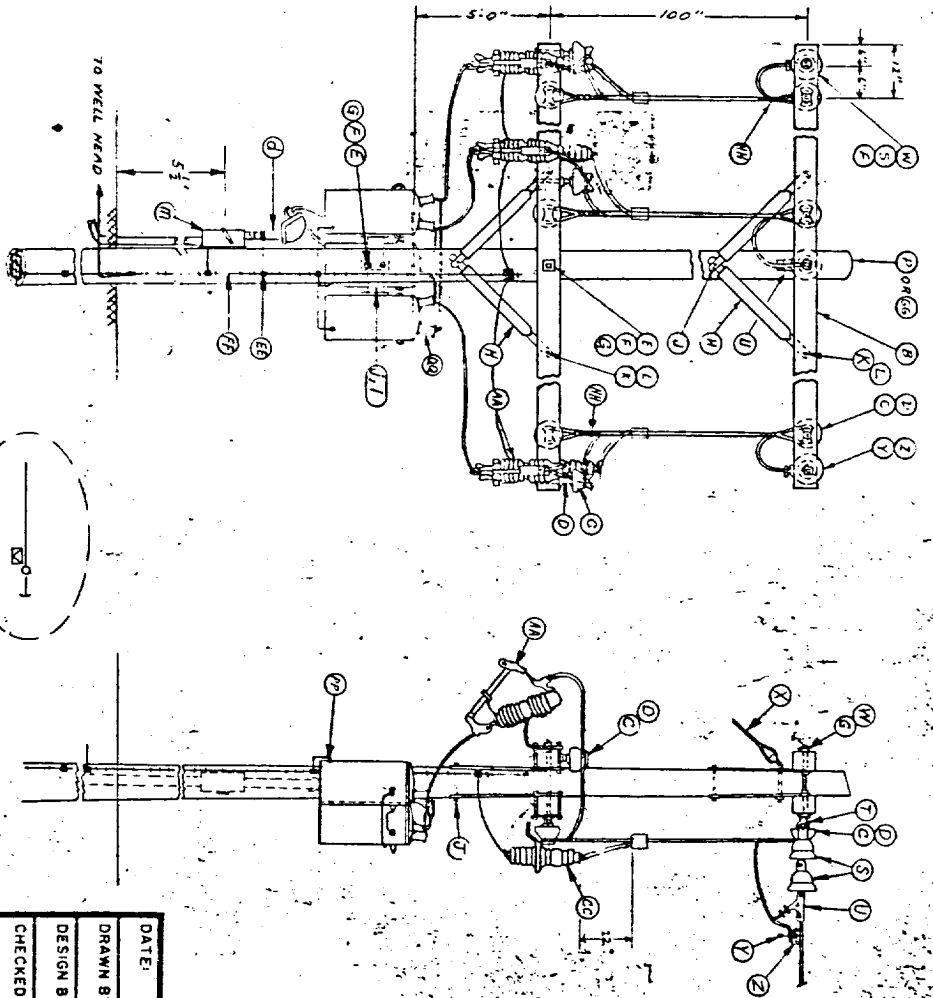

ITEM	QTY	REF
B	4	
C	9	
D	9	
E	3	
F	24	
G	12	
H	8	
J	4	
K	8	
L	8	
Package 1	1	ES1A, NOTE 5
5	6	
T	3	
U	3	
W	5	
X	1	
Y	3	
Z	3	
AA	3	
CC	3	
EE	8	
FE	1	
HH	6	
II	1	
JJ	1	ES1A NOTE 2
MM	1	
PP	3	
QQ	6	

NOTE:
 1. CENTER PHASE ON TANK WILL HAVE EPOXY INSULATOR, KEARNEY # 925019-24 IN'S. (REF. REFER TO DRAWING ES-20)
 2. ALL WIRE FROM POINT "U" WILL BE INSULATED TYPE WIRE ON TRANSFORMER TANK.

DATE:	12-13-71	TITLE:	SINGLE POLE SUBSTA.
DRAWN BY:	AKD	1PH. TRANS. CLUSTER MOUNT	
DESIGN BY:	AKD	PRIM. DEAD-END: 18500/480 V. AGSR	
CHECKED BY:		PRODUCTION DEPT.	CONOCO
APPROVED BY:		JOB:	HOBBS DIVISION
SCALE:	AS SHOWN	FILED SPECS	DRAWING NO. ES-9