


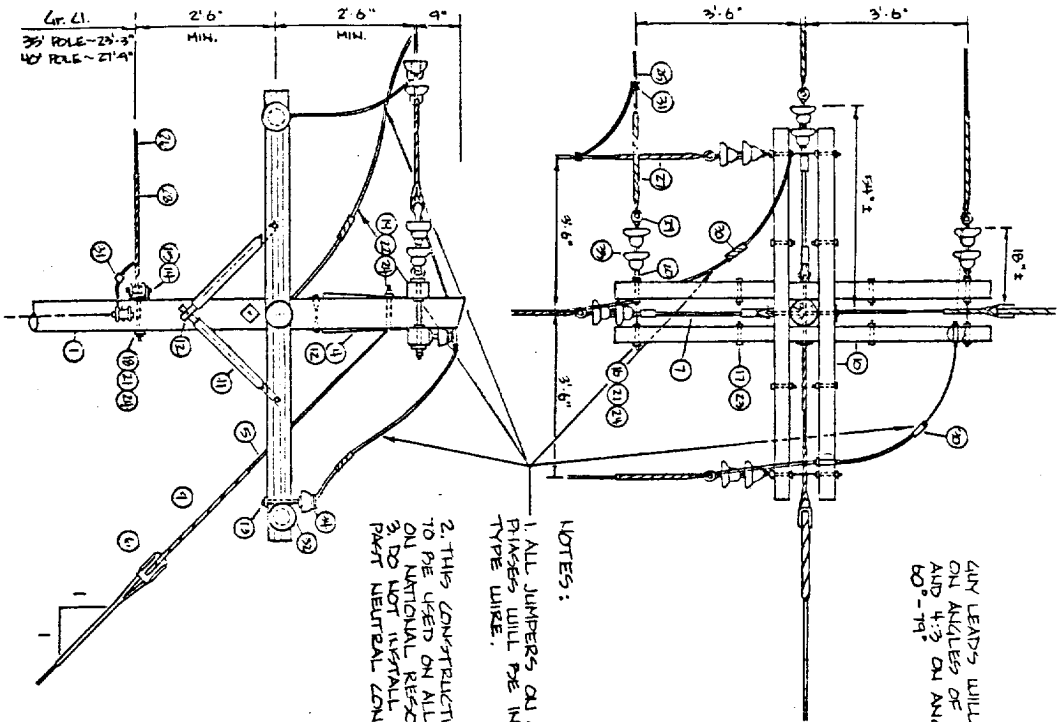

CON LEADS WILL BE 1:1 ON ANGLES OF 60°-90° AND 4:3 ON ANGLES OF 60°-79°

NOTES:

1. ALL JUMPERS ON CONDUCTOR PICES WILL BE INSULATED TYPE WIRE.

2. THIS CONSTRUCTION STANDARD TO BE USED ON ALL LINES BUILT ON NATIONAL RESOURCE LANDS, 3. DO NOT install ground wire, PWT NEUTRAL CONDUCTOR.

MATERIALS		DESCRIPTION	QUANTITY
ITEM	DESCRIPTION	QUANTITY	REMARKS
1	POLE	10'-2"	1
2	ANCHOR, 6"	5/8" x 7"	2
3	CONDUCTOR, 50.50L AL		2
4	CONDUCTOR, 50.50L AL		2
5	CONDUCTOR, 50.50L AL		2
6	CONDUCTOR, 50.50L AL		2
7	CONDUCTOR, 50.50L AL		2
8	CONDUCTOR, 50.50L AL		2
9	CONDUCTOR, 50.50L AL		2
10	CONDUCTOR, 50.50L AL		2
11	CONDUCTOR, 50.50L AL		2
12	CONDUCTOR, 50.50L AL		2
13	CONDUCTOR, 50.50L AL		2
14	CONDUCTOR, 50.50L AL		2
15	CONDUCTOR, 50.50L AL		2
16	CONDUCTOR, 50.50L AL		2
17	CONDUCTOR, 50.50L AL		2
18	CONDUCTOR, 50.50L AL		2
19	CONDUCTOR, 50.50L AL		2
20	CONDUCTOR, 50.50L AL		2
21	CONDUCTOR, 50.50L AL		2
22	CONDUCTOR, 50.50L AL		2
23	CONDUCTOR, 50.50L AL		2
24	CONDUCTOR, 50.50L AL		2
25	CONDUCTOR, 50.50L AL		2
26	CONDUCTOR, 50.50L AL		2
27	CONDUCTOR, 50.50L AL		2
28	CONDUCTOR, 50.50L AL		2
29	CONDUCTOR, 50.50L AL		2
30	CONDUCTOR, 50.50L AL		2
31	CONDUCTOR, 50.50L AL		2
32	CONDUCTOR, 50.50L AL		2
33	CONDUCTOR, 50.50L AL		2
34	CONDUCTOR, 50.50L AL		2

DATE: 7-15-77		TITLE: PRIMARY ANGLE STRUCTURE	
DRAWN BY: J. TRIPP		60°-90° 12500 VOLT WSR	
DESIGN BY:		CONOCO	
CHECKED BY: J. TRIPP		PRODUCTION DEPT.	
APPROVED BY: J. TRIPP		HOBBS DIVISION	
SCALE: 1/4"=1'-0"		DRAWING NO.: ES-27	