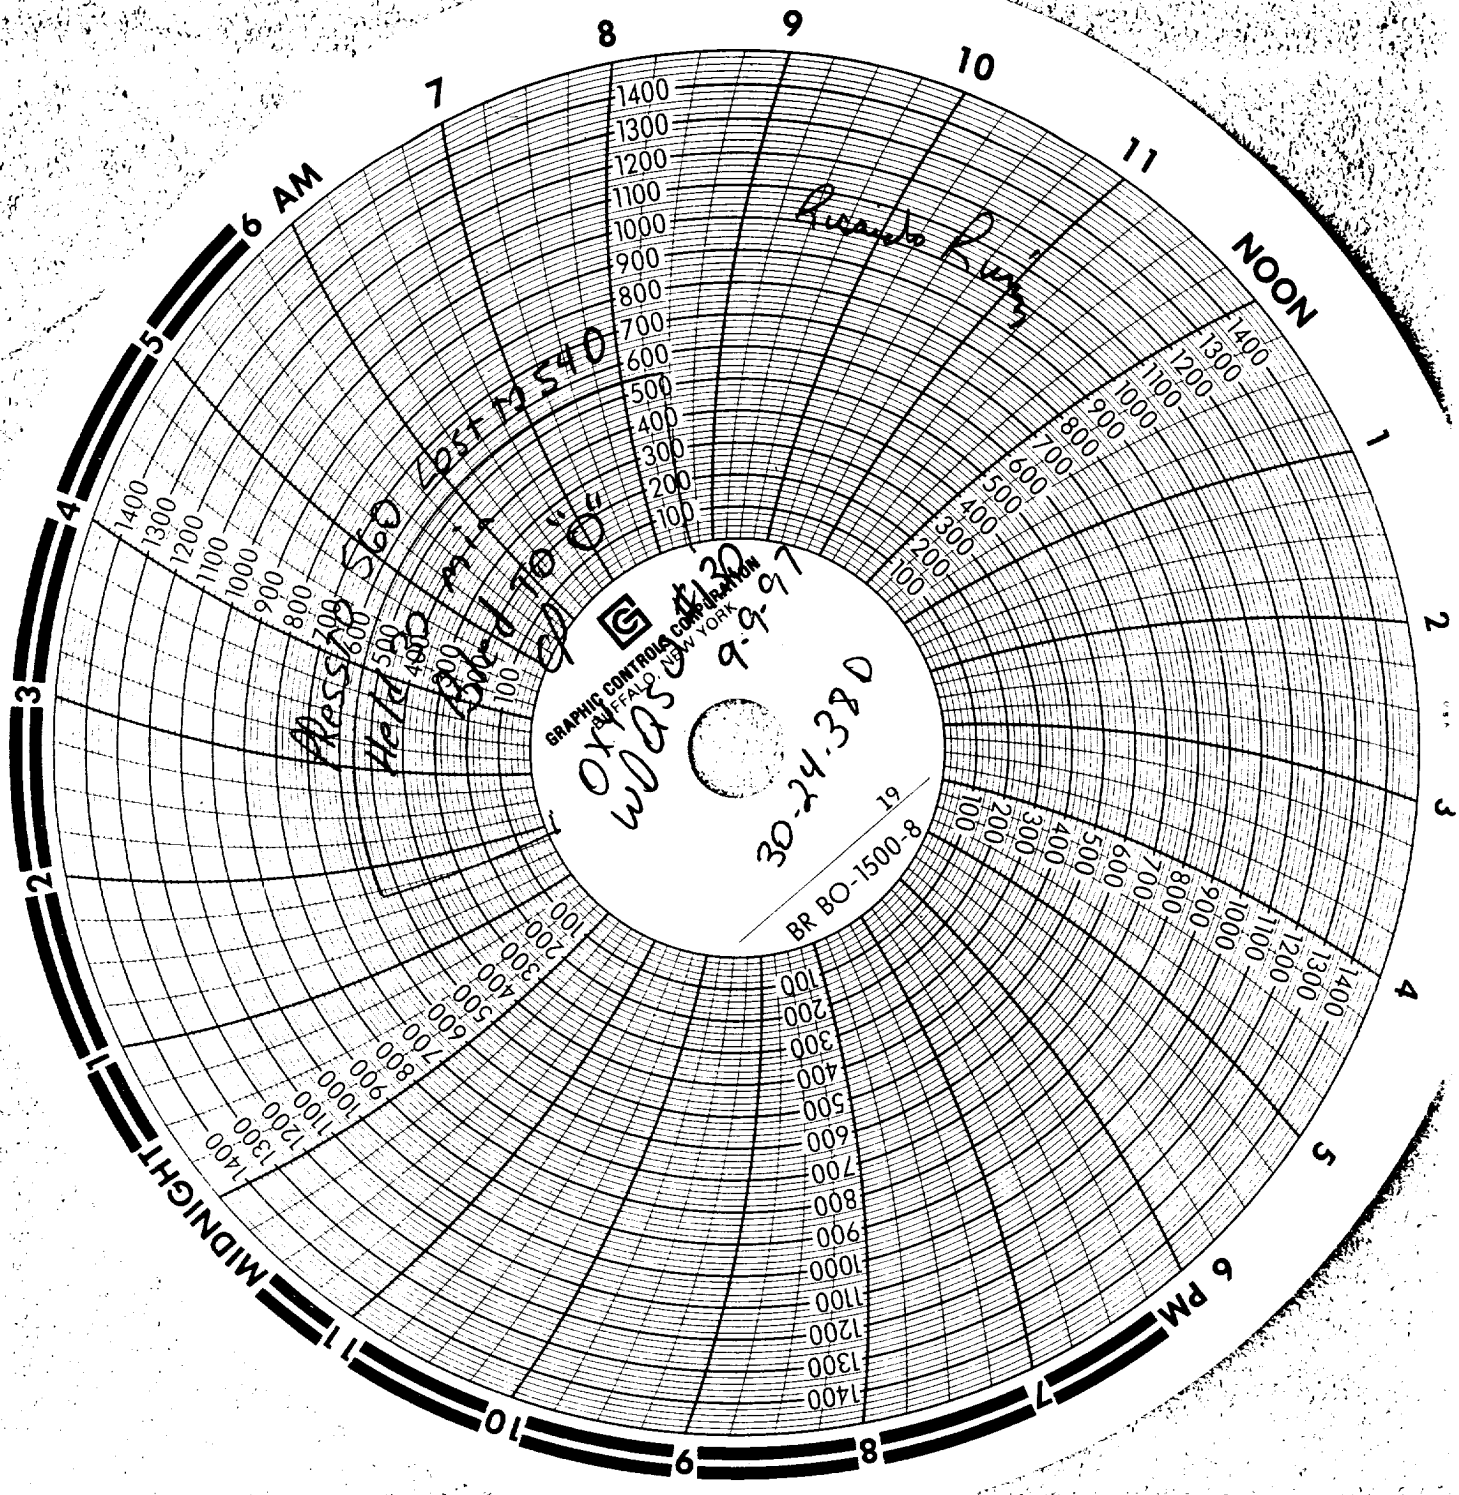
GRAPHIC CONTROLS CORPORATION
BUFFALO, NEW YORK
BR BO-1500-8
19
MIDNIGHT
6 AM
NOON
6 PM
Held 30 min
Bled to 0 psi
Lost 540
Pressure 560
Rigged Up
OXY
WDSU
9-9-97
30-24.380

TA

CIBP